


# Kazetová jednotka CT09~12F s panelem PT-QAGW0

[Unit: mm]

Chassis Code : TR  
 DWG No. : TBA36068201\_Rev02

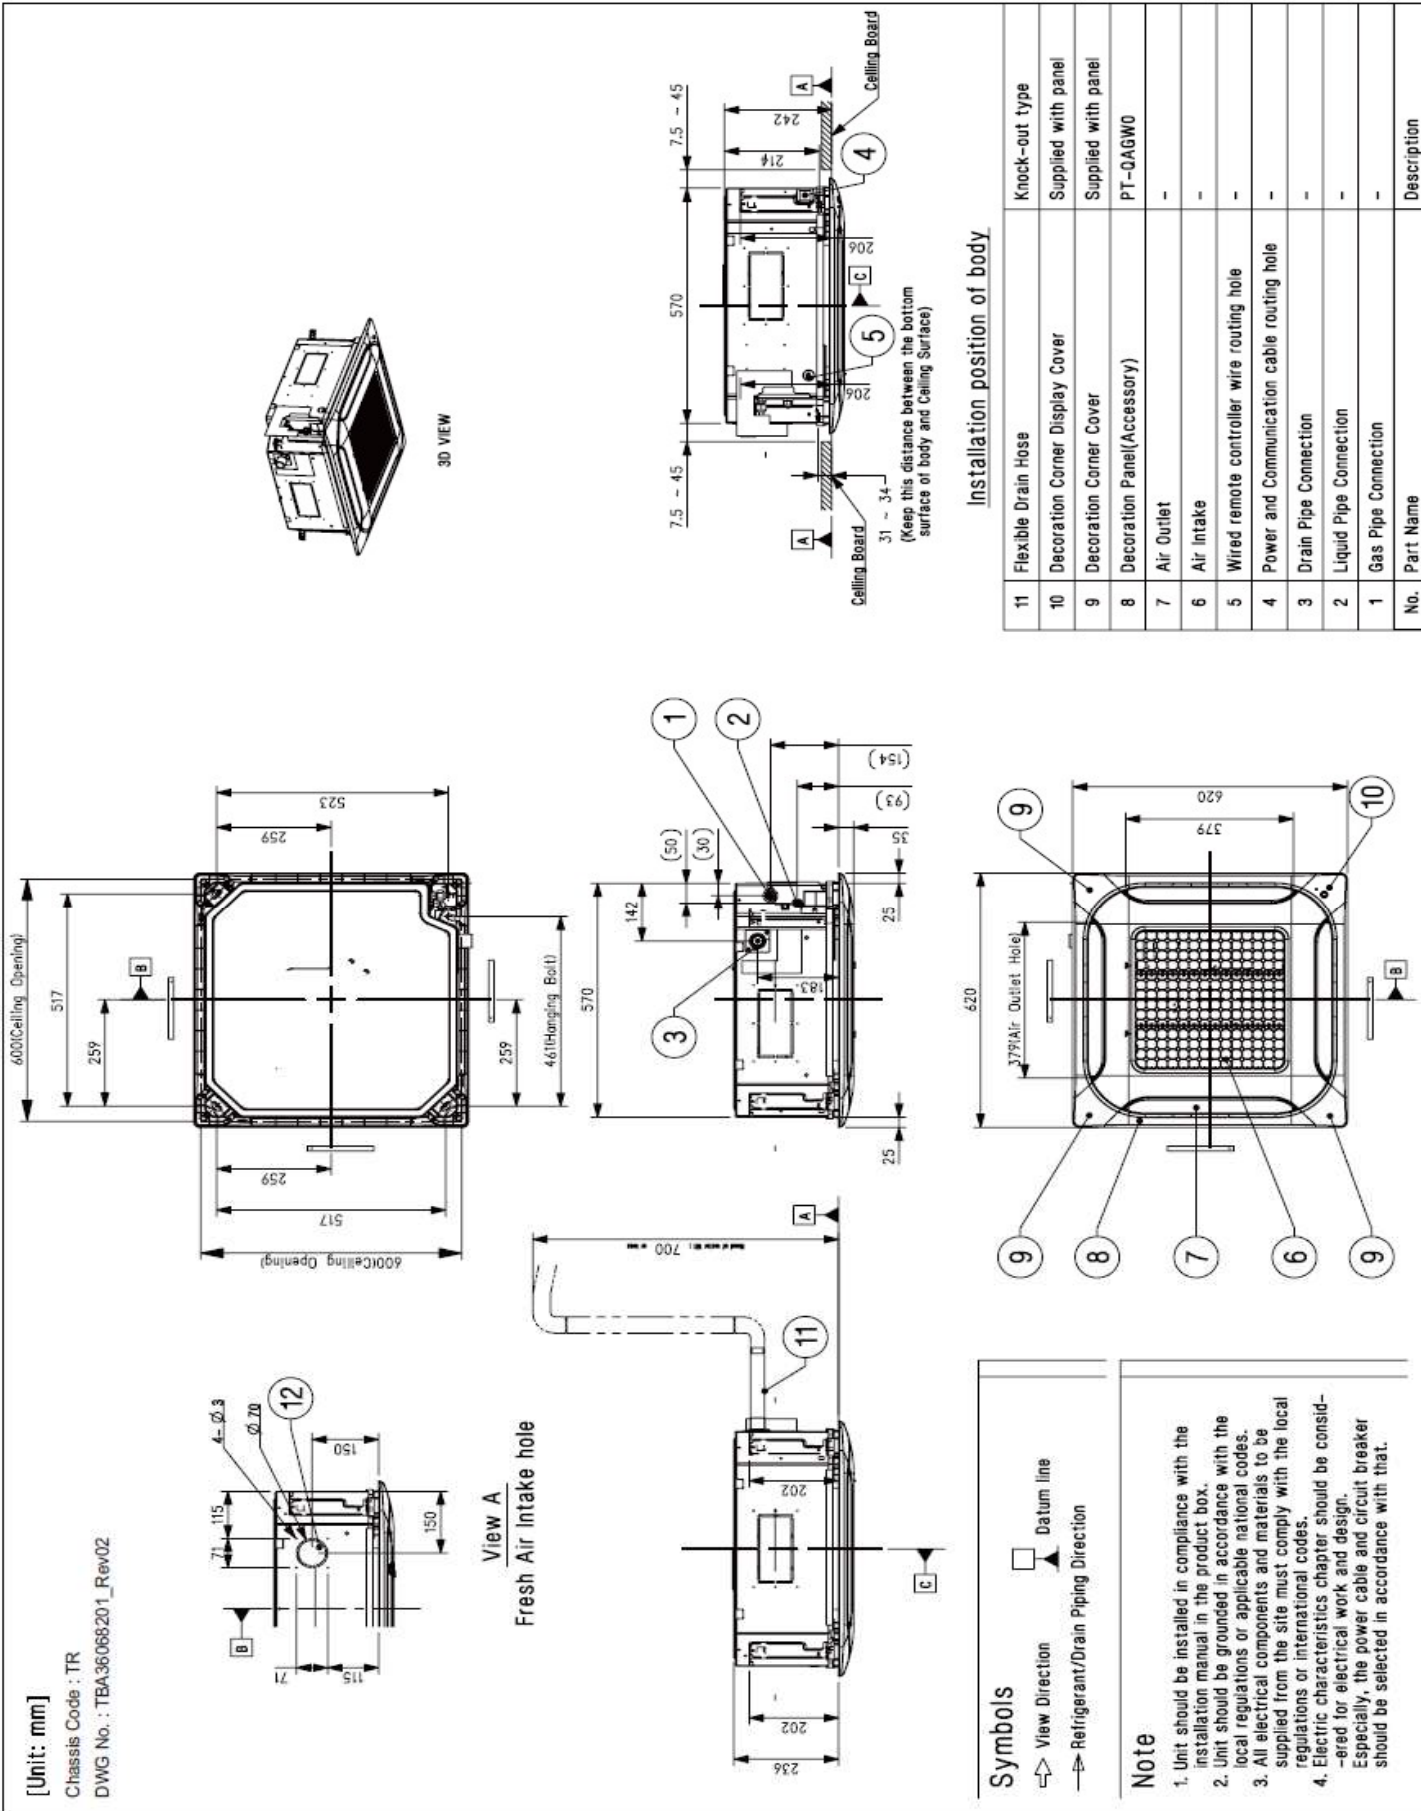

### Installation position of body

No.	Part Name	Knock-out type	Description
11	Flexible Drain Hose	-	
10	Decoration Corner Display Cover	Supplied with panel	
9	Decoration Corner Cover	Supplied with panel	
8	Decoration Panel(Accessory)	PT-QAGW0	
7	Air Outlet	-	
6	Air Intake	-	
5	Wired remote controller wire routing hole	-	
4	Power and Communication cable routing hole	-	
3	Drain Pipe Connection	-	
2	Liquid Pipe Connection	-	
1	Gas Pipe Connection	-	
No.	Part Name		Description

**Symbols**

- View Direction
- Datum line
- Refrigerant/Drain Piping Direction

**Note**

- Unit should be installed in compliance with the installation manual in the product box.
- Unit should be grounded in accordance with the local regulations or applicable national codes.
- All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
- Electric characteristics chapter should be considered for electrical work and design. Especially, the power cable and circuit breaker should be selected in accordance with that.